





The Clear Choice in Water Treatment

INSTALLATION LAYOUT FOR MODELS SC-50 / SC-100

INSTALLATION LAYOUT FOR HOUSEHOLDS

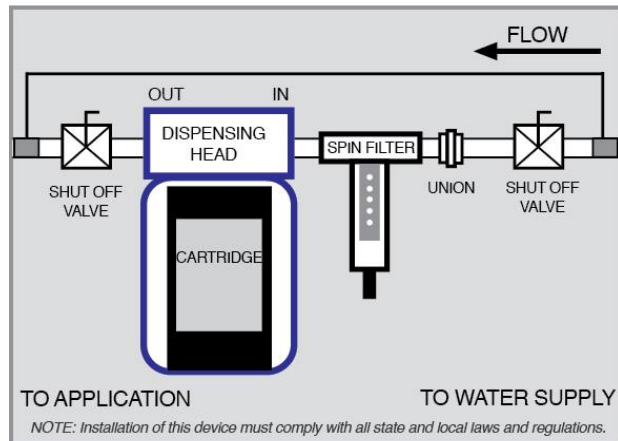

INSTALLATION LAYOUT FOR COMMERCIAL USE

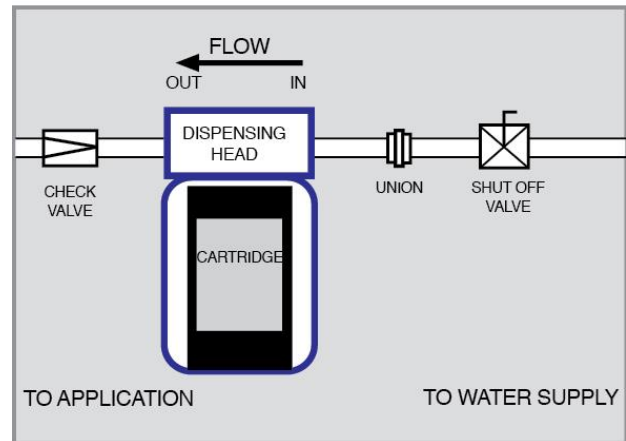

INSTALLATION INSTRUCTIONS

- Use a pressure reducer if the water pressure is higher than 55 PSI.
- Install a check valve after the water unit as required to prevent backflow.
- **DO NOT** remove end caps from the (replaceable) cartridge.
- **DO DISCARD** the orange moisture cap **PRIOR** to cartridge installation.
- Inlet and Outlet are 3/4" NPT (female)

UNIT MOUNTING INSTRUCTIONS

1. Mount the unit with the supplied bracket to a wall or a piece of equipment that can support the weight of the unit.
2. Mount the units' head - **horizontally** - with the sump below it. **The unit will not function properly in any other orientation.**
3. Connect the necessary plumbing (refer to diagram above). A check valve may be installed after the unit. Also, install a shut-off valve on the inlet side of the head and the outlet side of the head to facilitate the removal of the sump for cartridge replacement.
4. Mount the unit out of direct sunlight and out of excessive or freezing temperatures.

NOTE: Periodically check the SCALTROL cartridge and use only genuine replacements
Replace the cartridge when the level of Scaltrrol mixture reaches the bottom end cap

Scaltrrol, Inc. • 2410 Satellite Blvd., Suite M • Buford, Georgia 30518
Mailing address: P.O. Box 3288 • Suwanee, Georgia 30024
Phone: 800-868-0629 ext. 201 • Fax: 877-769-2751 • www.scaltrrolinc.com