



The Clear Choice in Water Treatment

INSTALLATION LAYOUT FOR MODEL SC-500


INSTALLATION LAYOUT FOR COMMERCIAL USE

INSTALLATION INSTRUCTIONS

- Use a pressure reducer if the water pressure is higher than 100 psi.
- Install a check valve after the water unit as required to prevent backflow.
- **DO NOT DISCARD** the plastic disk on top of the compound inside the sump.
- Inlet and Outlet are 1-1/2" NPT (female)

UNIT MOUNTING INSTRUCTIONS

1. Mount the unit with the supplied bracket to a wall or a piece of equipment that can support the weight of the unit.
2. Mount the units' head - **horizontally** - with the sump below it. **The unit will not function properly in any other orientation.**
3. Connect the necessary plumbing (refer to diagram above). A check valve may be installed after the unit. Also, install a shut-off valve on the inlet side of the head and on the outlet side of the head to facilitate the removal and replacement of the sump.
4. Mount the unit out of direct sunlight and out of excessive or freezing temperatures.

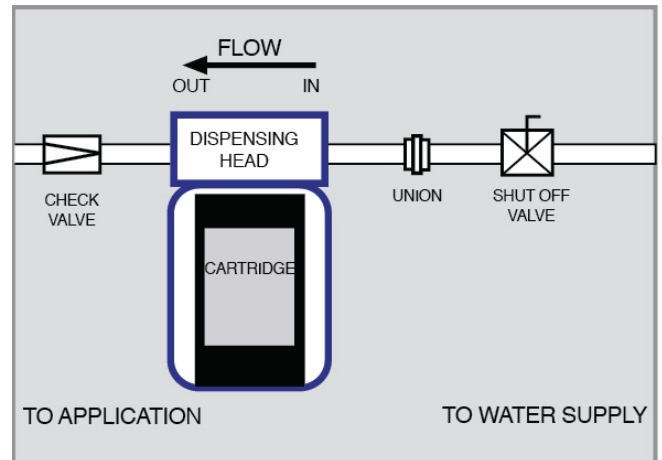

NOTE: Periodically check the SCALTROL cartridge and use only genuine replacements

Replace the cartridge when the level of Scaltrol mixture reaches the bottom of the sump.

Scaltrol Inc. • 2410 Satellite Blvd. NE, Suite M • Buford, GA 30518

Mailing address: P.O. Box 3288 • Suwanee, GA 30024

Phone: 800-868-0629 • Fax: 877-769-2751 • Scaltrolinc.com